ATTENTION

SALINE COUNTY CUSTOMERS

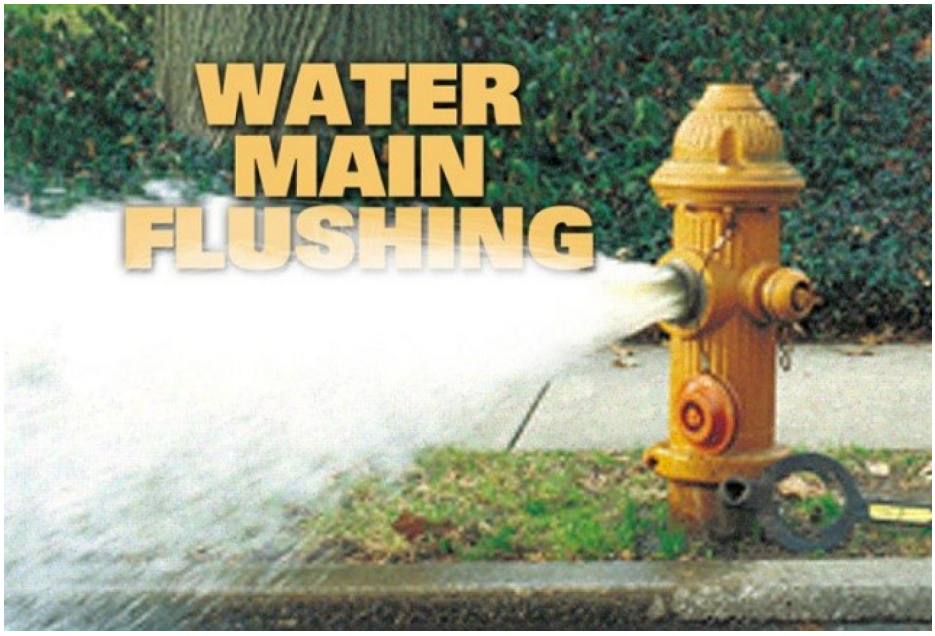

Starting this week Marshall Municipal Utilities began a Free Chlorine Conversion at the water treatment plant in Marshall. During this time they will cease feeding ammonia and feed only chlorine to disinfect the water. This practice is part of the annual routine maintenance for the water distribution system.

During this time, you do not need to do anything different unless you are a dialysis patient, then please contact your health care professional with any questions.

C-PWSD No. 2 customers may notice a difference in taste and or smell of the water over the next 4 - 6 weeks. C-PWSD No. 2 maintenance staff will begin flushing the water lines in Saline County the week of October 5, 2026 and there will be times where your residence has no water. Rest assured, we will complete this process as quickly as possible while ensuring the water is safe to consume.

While we are flushing, you may want to avoid washing any light or white colored clothing.

Thank you for your cooperation and understanding during this time of routine maintenance!